

Report in Accordance with
BS EN ISO 10077-1:2017

**Thermal Performance of
Windows, Doors & Shutters**

Calculation of Thermal Transmittance
Part 1: Simplified Method

CONFIDENTIAL

Report reference: CU21577-37

Issue date: 16 May 2022

Project: Aluminium Korniche Bi-Fold Doorset

Prepared for: Aanco (UK) Ltd
T/A Made For Trade
Wellington House, Wynyard Avenue
Wynyard
Billingham TS22 5TB

Prepared by: Sue Peatey

Build Check Ltd
Unit 5
Lincoln Park Business Centre
Lincoln Road
High Wycombe
Bucks HP12 3RD

Tel: 01494 452713
E-mail: info@buildcheck.co.uk

UK Approved Body: 1806

This document is confidential and remains the property of Build Check Ltd

Opinions and interpretations expressed herein are outside the scope of UKAS accreditation

The legal validity of this report can only be claimed on presentation of the complete report.

1 Introduction

This document details the thermal performance calculation of the doorset configuration as detailed below.

The results in this report relate only to the specimen tested and as drawings and specification received.

The frame profile results detailed below are provided by computer simulation using LBL software program THERM 5.2 and validated against proofs in Annex I (I1 to I10) of BS EN ISO 10077-2:2017. The frame profile results detailed below are provided from methods contained in BS EN ISO 10077-1:2017 and in accordance with thermal transmittance requirements detailed in BS EN 14351-1:2006 +A1:2010. Cavities are calculated in accordance with BS EN ISO 10077-2 section 6.4.3 Treatment of cavities using the single equivalent thermal conductivity method.

2 Summary of Results

2.1 Frame thermal transmittance (in accordance with BS EN ISO 10077-1: 2017)

Frame Profile	Frame Thermal Transmittance (U_f)
Left Jamb	3.0 W/m ² K
Right Jamb	2.8 W/m ² K
Head	2.9 W/m ² K
Threshold	2.9 W/m ² K
Meeting Stile	2.3 W/m ² K

2.2 Linear thermal transmittance (in accordance with BS EN ISO 10077-1: 2017)

Frame Profile	Linear Thermal Transmittance (ψ)
Left Jamb	0.040 W/m.K
Right Jamb	0.037 W/m.K
Head	0.037 W/m.K
Threshold	0.037 W/m.K
Meeting Stile	0.084 W/m.K

2.3 Centre pane U-Value of glazing calculated in accordance with BS EN 673: 2011

Glazing unit	Centre pane U-value (U_g)
Nominal dimensions 4-18-6.8 90% argon 10% air filled, normal emissivity 0.01 (4mm float, 18mm Superspacer Premium, 6.8mm Pilkington S1+)	1.1 W/m ² K

The legal validity of this report can only be claimed on presentation of the complete report.



2.4 U-Value

The thermal performance of the doorset (U_d) in accordance with EN ISO 10077-1:2017 is:

1.6 W/m²K


All profile calculations based on BS EN ISO 10077-2:2017

3 Authorisation

	Issued by:	Checked by:
Signature:		
Name:	Sue Peatey	Richard Bate
Title:	Laboratory Manager	Technical Director

The legal validity of this report can only be claimed on presentation of the complete report.


Figure 1. Technical drawing of Head profile.

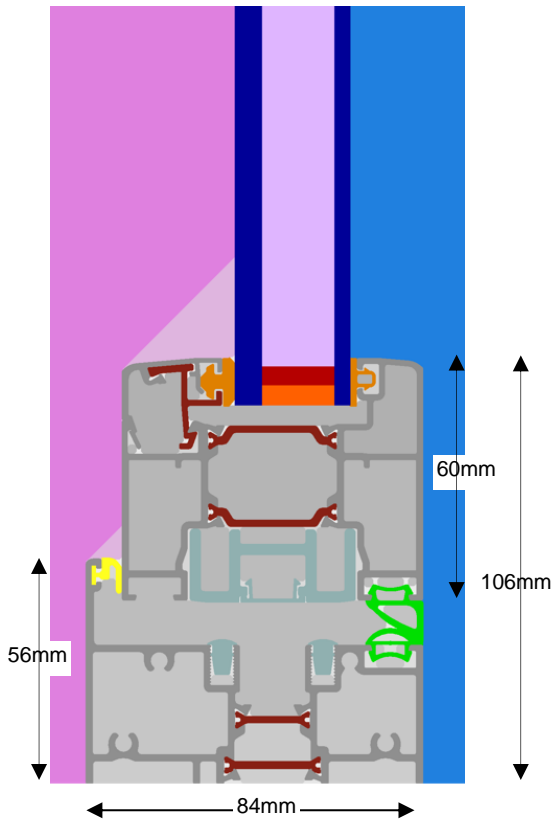

	Material	Thermal Conductivity W/(m.K)
	PVC-U Rigid, BS EN 10077-2	0.17
	PVC Flexible, BS EN 10077-2	0.14
	Aluminium, BS EN 10077-2	160.0
	Soda Lime Glass, BS EN 10077-2	1.0
	Superspacer Premium, IFT Rosenheim report 13-002649-PR02 (declared value)	0.15
	Hot Melt Butyl, BS EN 10077-2	0.24
	Polyurethane Foam, BS 10456	0.05
	EPDM, BS EN 10077-2	0.25
	Polyamide (1.8 & 2mm thick), BS EN 10077-2	0.30

The legal validity of this report can only be claimed on presentation of the complete report.


Figure 2. Technical drawing of Threshold profile.

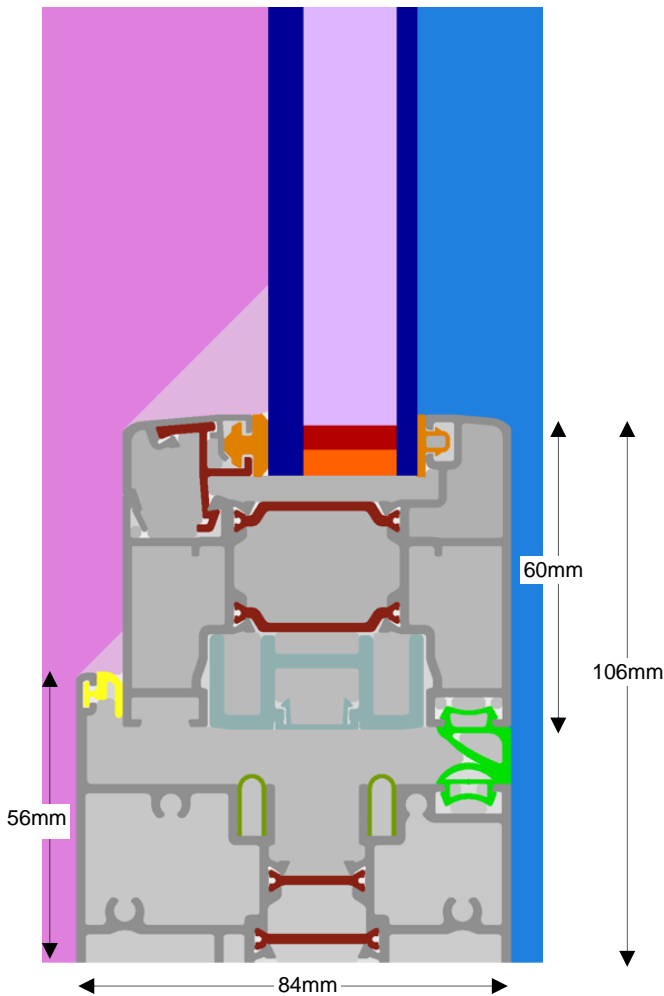







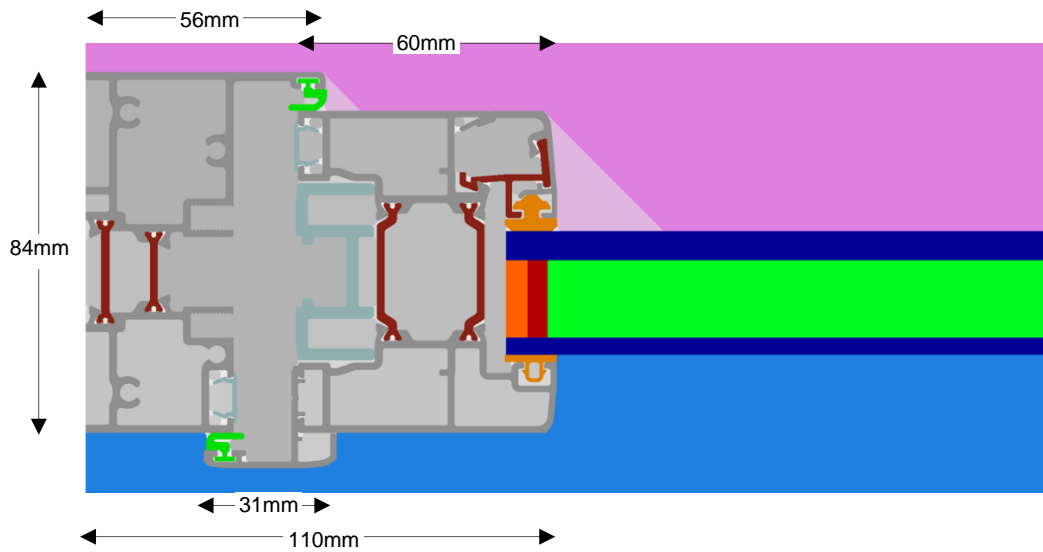


	Material	Thermal Conductivity W/(m.K)
	PVC-U Rigid, BS EN 10077-2	0.17
	PVC Flexible, BS EN 10077-2	0.14
	Aluminium, BS EN 10077-2	160.0
	Soda Lime Glass, BS EN 10077-2	1.0
	Superspacer Premium, IFT Rosenheim report 13-002649-PR02 (declared value)	0.15
	Hot Melt Butyl, BS EN 10077-2	0.24
	Polyurethane Foam, BS 10456	0.05
	EPDM, BS EN 10077-2	0.25
	Polyamide (1.8 & 2mm thick), BS EN 10077-2	0.30

The legal validity of this report can only be claimed on presentation of the complete report.


Figure 3. Technical drawing of Left Jamb profile.









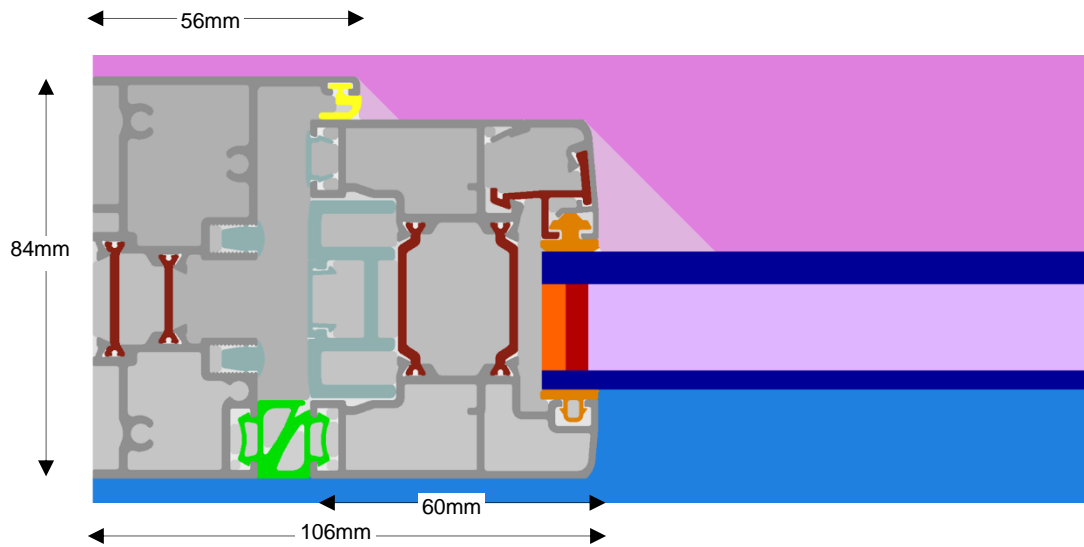


	Material	Thermal Conductivity W/(m.K)
	PVC-U Rigid, BS EN 10077-2	0.17
	PVC Flexible, BS EN 10077-2	0.14
	Aluminium, BS EN 10077-2	160.0
	Soda Lime Glass, BS EN 10077-2	1.0
	Superspacer Premium, IFT Rosenheim report 13-002649-PR02 (declared value)	0.15
	Hot Melt Butyl, BS EN 10077-2	0.24
	Polyurethane Foam, BS 10456	0.05
	EPDM, BS EN 10077-2	0.25
	Polyamide (1.8 & 2mm thick), BS EN 10077-2	0.30

The legal validity of this report can only be claimed on presentation of the complete report.


Figure 4. Technical drawing of Right Jamb profile.



	Material	Thermal Conductivity W/(m.K)
	PVC-U Rigid, BS EN 10077-2	0.17
	PVC Flexible, BS EN 10077-2	0.14
	Aluminium, BS EN 10077-2	160.0
	Soda Lime Glass, BS EN 10077-2	1.0
	Superspacer Premium, IFT Rosenheim report 13-002649-PR02 (declared value)	0.15
	Hot Melt Butyl, BS EN 10077-2	0.24
	Polyurethane Foam, BS 10456	0.05
	EPDM, BS EN 10077-2	0.25
	Polyamide (1.8 & 2mm thick), BS EN 10077-2	0.30

The legal validity of this report can only be claimed on presentation of the complete report.


Figure 5. Technical drawing of Meeting Stile profile.

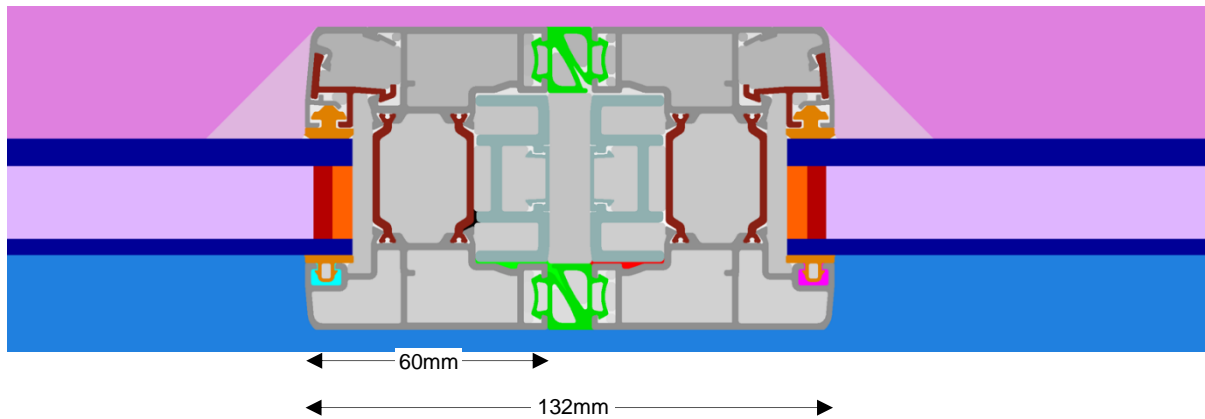

	Material	Thermal Conductivity W/(m.K)
	PVC-U Rigid, BS EN 10077-2	0.17
	PVC Flexible, BS EN 10077-2	0.14
	Aluminium, BS EN 10077-2	160.0
	Soda Lime Glass, BS EN 10077-2	1.0
	Superspacer Premium, IFT Rosenheim report 13-002649-PR02 (declared value)	0.15
	Hot Melt Butyl, BS EN 10077-2	0.24
	Polyurethane Foam, BS 10456	0.05
	EPDM, BS EN 10077-2	0.25
	Polyamide (1.8 & 2mm thick), BS EN 10077-2	0.30

The legal validity of this report can only be claimed on presentation of the complete report.

Figure 6. Drawing of the doorset configuration and overall dimensions (from the internal face)

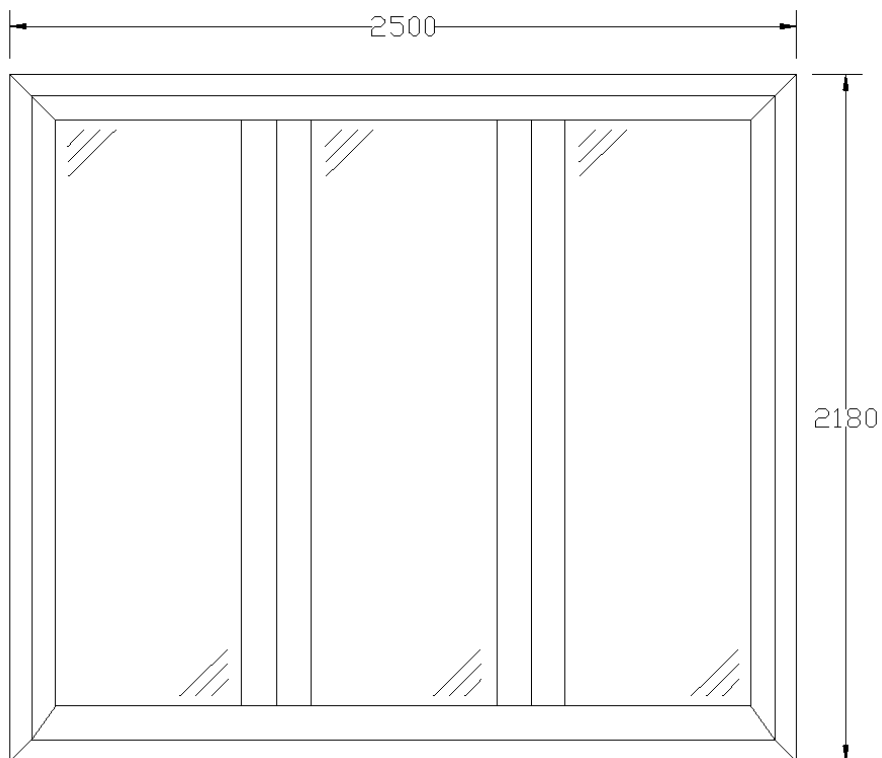

Internal projected frame area ($A_{f,i}$)	1.475 m ²
External projected frame area ($A_{f,e}$)	1.475 m ²
Glazed area of configuration (A_g)	3.975 m ²
Frame area of configuration (A_f)	1.475 m ²
Perimeter length of the glazing (l_g)	15.848 m

Glazing unit 4-18-6.8 Low E 0.01 uncorrected 90% argon 10% air filled

BS EN 673:2011 Glass in building- Determination of thermal transmittance (<i>U</i> value)-Calculation method.				
Standardised boundary conditions (section 8)				
<i>r</i>	1	m.K/w		Thermal resistivity of soda lime glass
ϵ glass	0.837			Corrected emissivity of uncoated soda lime and borosilicate glass surface
ΔT	15	K		Temperature difference between bounding glass surface
<i>T_m</i>	283	K		Mean temperature of gas space
σ	5.67E-08	W/(m ² K ⁴)		Stefan-Boltzmann's constant
<i>h_e</i>	25	W/(m ² K)		External heat transfer coeff. for uncoated soda lime glass surfaces
<i>h_i</i>	7.7	W/(m ² K)		Internal heat transfer coeff. for uncoated soda lime glass surfaces
<i>A</i>	0.035			Constant
<i>n</i>	0.38			Exponent
Gas properties (section 6)				
Density: ρ	1.6523	kg/m ³		
Dynamic viscosity: μ	2.12E-05	kg/(ms)		
Thermal conductance: λ	0.017652	W/(m.K)		
Specific Heat Capacity: <i>c</i>	567.9	J/(kg.K)		
<i>s</i>	0.018	m		width of gas space
ϵ_1	0.837			corrected emissivity of surface 1
ϵ_2	0.013			corrected emissivity of surface 2
Glass pane 1 <i>d</i>	0.004	m		thickness of glass 1
Glass pane 2 <i>d</i>	0.0068	m		thickness of glass 2
Calculated values				
<i>Pr</i>	6.83E-01			
<i>Gr</i>	1.84E+04			
<i>Nu</i>	1.26E+00	1	1.26E+00	If <i>Nu</i> is less than 1, use <i>Nu</i> = 1.
<i>h_r</i>	6.46E-02			
<i>h_g</i>	1.24E+00			
<i>h_s</i> = <i>h_r</i> + <i>h_g</i>	1.30E+00			
1/ <i>h_t</i>	7.78E-01			
1/ <i>U</i> = 1/ <i>h_e</i> + 1/ <i>h_t</i> + 1/ <i>h_i</i>	9.48E-01			
Centre pane <i>U</i> value	1.055			

The legal validity of this report can only be claimed on presentation of the complete report.